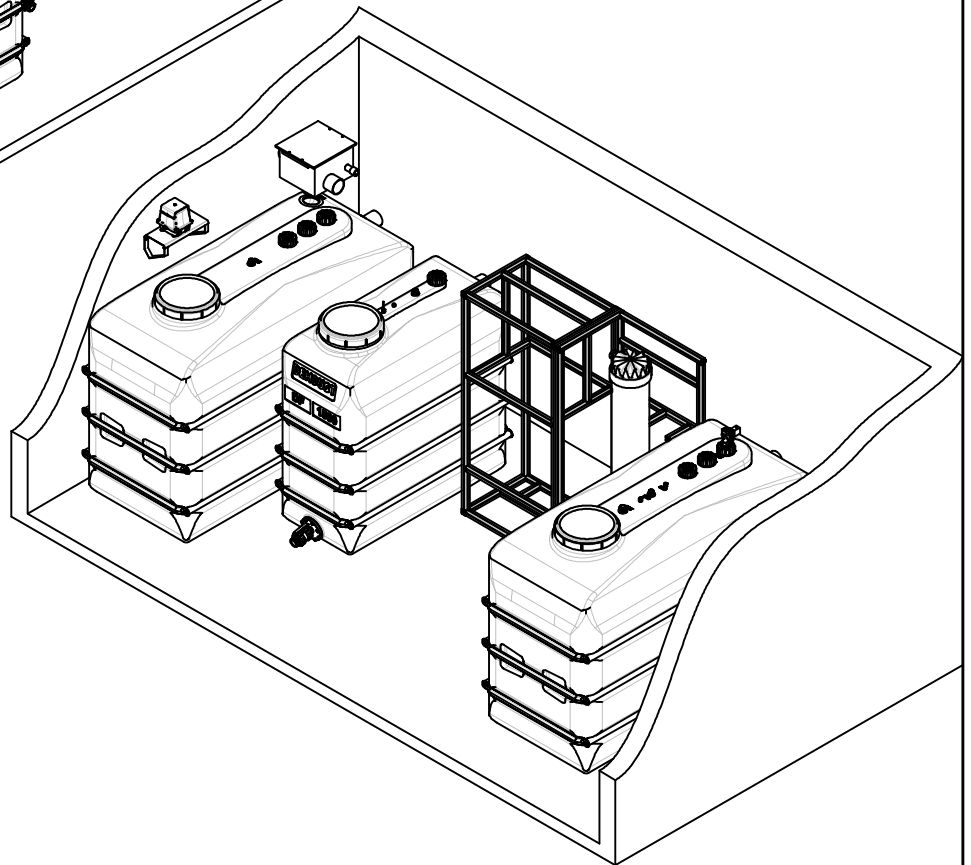
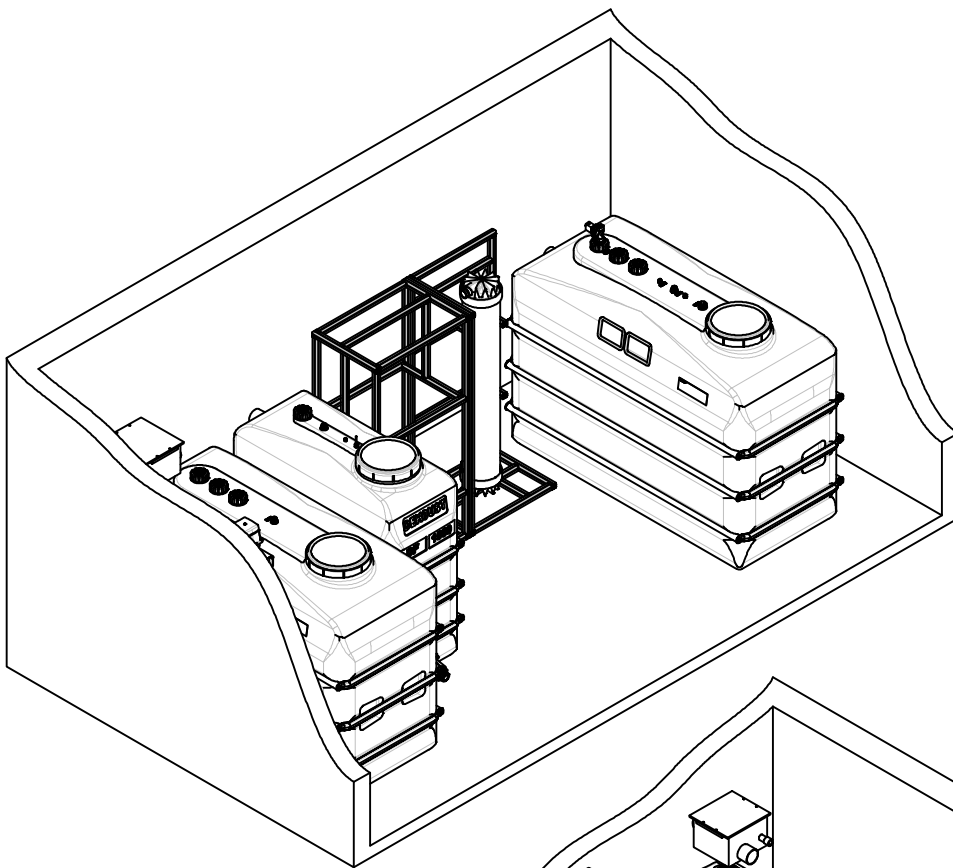



ISO Methode E

Bemerkungen:

Allgemeintoleranzen nach DIN 28005-1

Vorlage-Zeichnung-Nr.:

	Datum	Name	Projekt-Nr.:	Artikel-Nr.:	Maßstab
Bearb.	28.06.2023	sk		813371	
Gepr.			Kunde:		Werkstoff
Norm.					
Medium			Kommission:		Gewicht
DEHOUST 69181 Leimen Gutenbergstraße 5-7 Tel 06224/97020			Behälterbezeichnung	Behälter-Nr.:	
			Grauwasseranlage DEHOUST GWtec® 140		
			Zeichnungs-Nr.:	Auftrags-Nr.:	Blattgröße: Blatt-Nr.: Blattzahl:
			D627584		A4 1 3

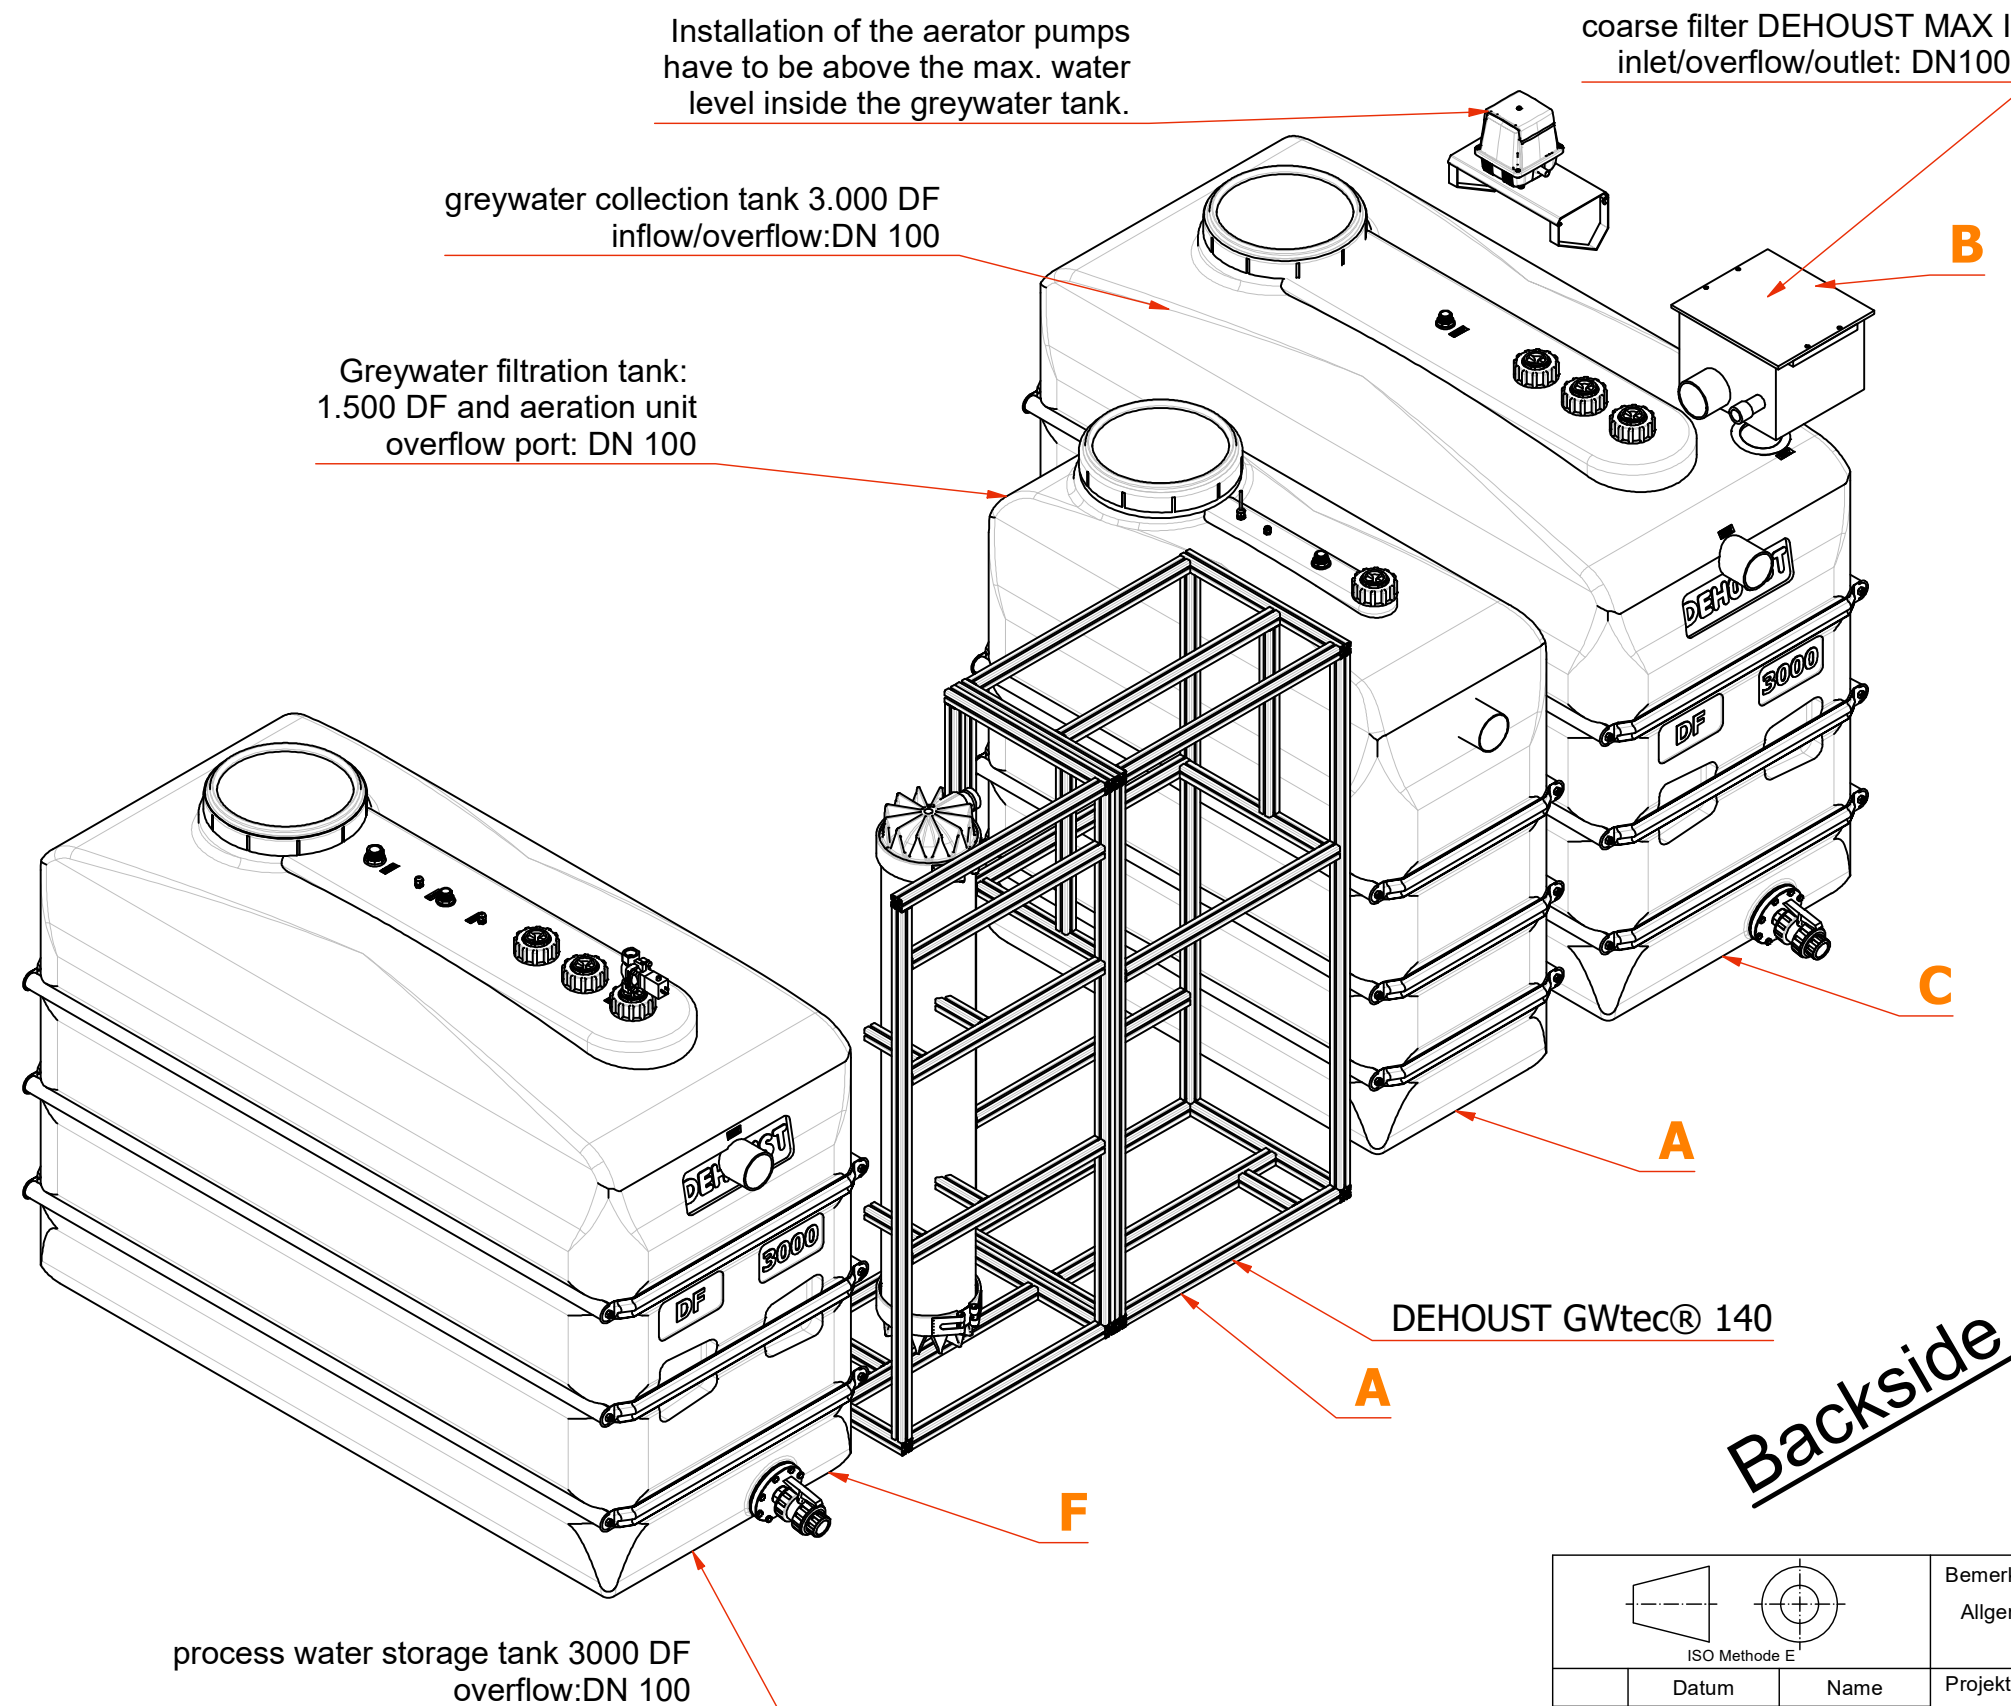

(A)
Type: DEHOUST GWtec® 140
Item: 813371
treatment capacity: ~ 5,000 litres/day
weight: 95 kg

Greywater filtration tank: 1x PE HD 1.500 DF incl. aeration
overflow port: DN 100
drain valve: 121" female thread
1" PVC flex hose blue, 2 m
Empty weight: 75 kg

(B)
Type: coarse filter DEHOUST MAX I
Item: 812651
inlet/overflow/outlet: DN100
Connection backwash: 21" female; pmin: 1 bar; pmax: 2 bar
empty weight: 8 kg

(C)
Type: greywater collection tank 3.000 litres
Item: 962057
inflow/overflow: DN 100
Drain valve: 121" female thread
Empty weight: 165 kg

(D)
Type: extension package aeration unit
Item: 813442
PVC flex hose: 43" female thread, red length: 5m

(E)
Type: greywater batch pump DOC 3
Item: 813443
PVC flex hose: 1" female thread, black, length: 5m

(F)
Type: process water storage tank 3000
Item: 962056
overflow: DN 100
Connection mains water back up: 1" female ; pmin: 1 bar; pmax: 10 bar
Emergency overflow DIN EN 1717: LxW 2 x 200 x 125 mm
Drain valve: 121" female thread
Empty weight: 165 kg

Overall technical specification
Total weight: 540 kg
electrical load: 400 V / 16 A / 50 Hz / 2,61 kW

Pipes not included in delivery:


In- and overflow pipe DN 150
Pressure line backwash pump DN 32 (1 1/4") from tank F to DEHOUST GWtec® A
Pressure line booster pump DN 25 (1") from DEHOUST GWtec® to coarse filter DEHOUST MAX I B



Installation of air compressor have to be above the max. water level
inside the greywater tank.


Dimensions in mm; distance to wall min. 300 mm.

*Height depends on the installation material

Technical change reserved. This installation example is subject to change.
All transactions are subject to our general terms and conditions.

 ISO Methode E			Bemerkungen: Allgemeintoleranzen nach DIN 28005-1		Vorlage-Zeichnung-Nr.:
	Datum	Name	Projekt-Nr.:	Artikel-Nr.:	Maßstab
Bearb.	28.06.2023	sk		813371	
Gepr.			Kunde:		Werkstoff
Norm.					
Medium			Kommission:		Gewicht
 69181 Leimen Gutenbergstraße 5-7 Tel 06224/97020			Behälterbezeichnung Grauwassieranlage DEHOUST GWtec® 140		Behälter-Nr.:
			Zeichnungs-Nr.:	Auftrags-Nr.:	Blattgröße:
			D627584		A3
					Blatt-Nr.: 2 Blattzahl: 3

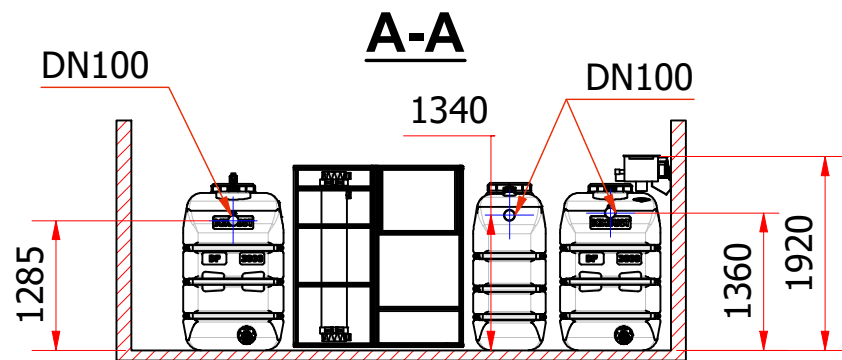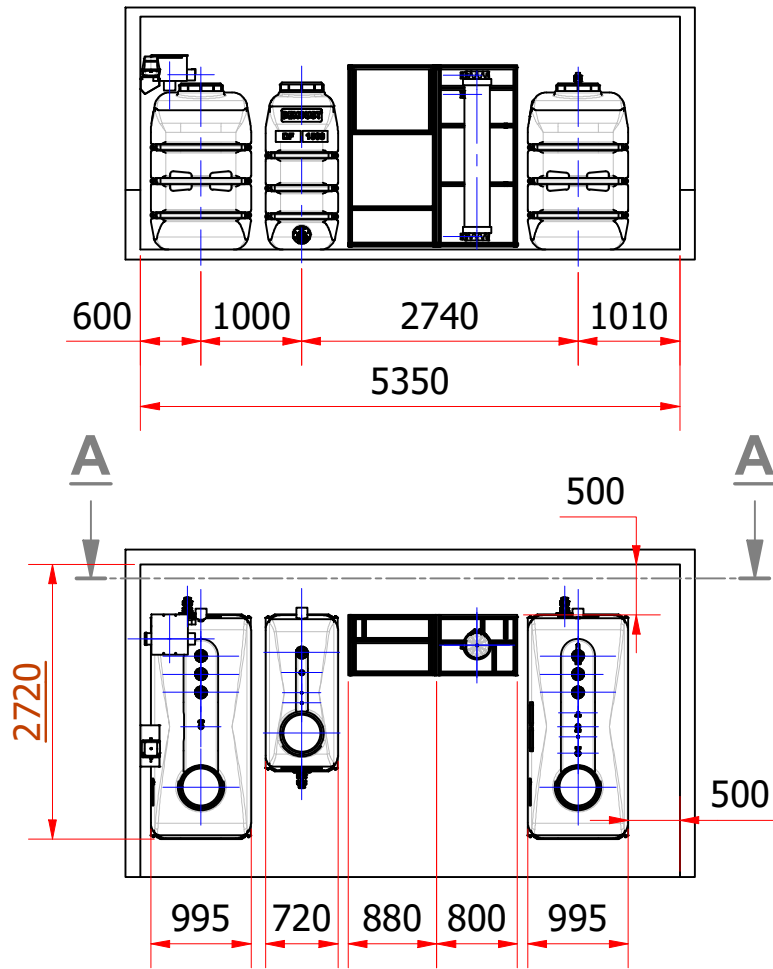

 ISO Methode E			Bemerkungen: Allgemeintoleranzen nach DIN 28005-1			Vorlage-Zeichnung-Nr.:		
	Datum	Name	Projekt-Nr.:		Artikel-Nr.:		Maßstab	
Bearb.	28.06.2023	sk			813371			
Gepr.			Kunde:					Werkstoff
Norm.								
Medium			Kommission:					Gewicht
 69181 Leimen Gutenbergstraße 5-7 Tel 06224/97020			Behälterbezeichnung			Behälter-Nr.:		
			Grauwasseranlage DEHOUST GWtec® 140					
			Zeichnungs-Nr.:		Auftrags-Nr.:		Blattgröße:	Blatt-Nr.:
			D627584				A4	3
							Blattzahl:	3